


MDT Faraday Cage


Electrical Services

Patch Panel and CSM are Centrally Located on most chambers:

(top view)

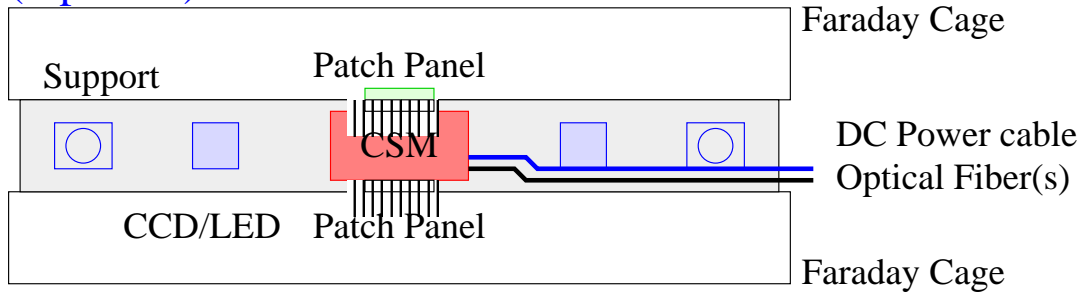


Specific Cases Studied (end views):

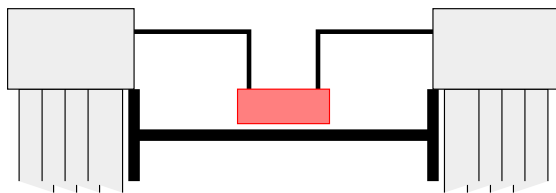


BOL, BML, BOS

317mm spacer

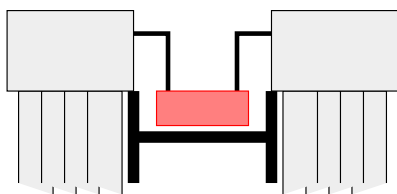


BIL, BMS, BOG, BOH
BMF, BIR


170mm spacer

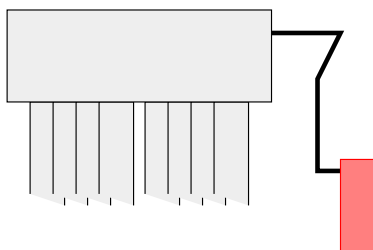

BIS



BEE

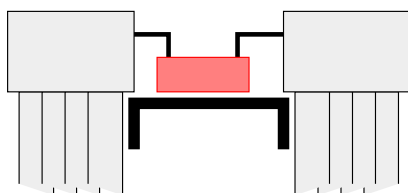

Endcap
Chambers (all)